


METALAIRE™

Submission: TH500-004




Single Duct Air Terminal Unit With Integral Attenuator

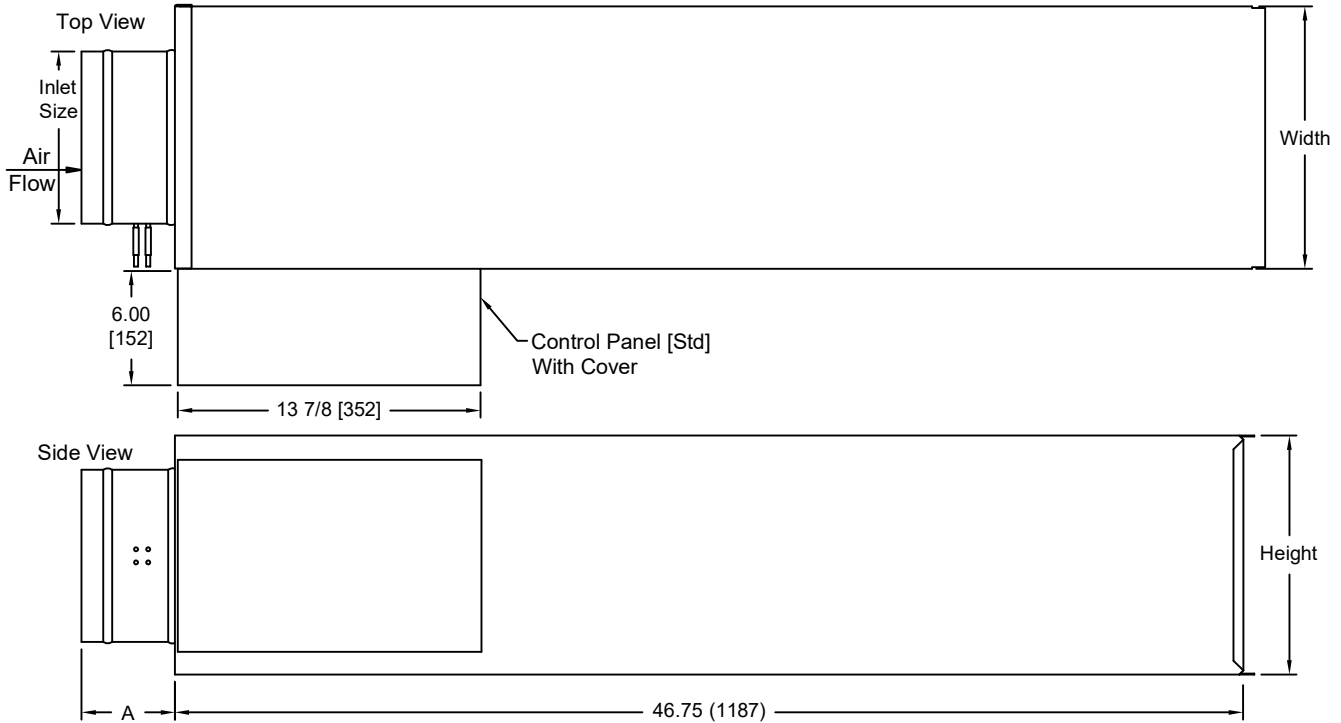

The standard location for control panel is Right Hand on Single Duct Air Terminal Unit. Looking in the direction of airflow, the control panel is on the right.

Unit Size	Inlet Size		A		Width		Height		Unit wt.	
	in.	mm.	in.	mm.	in.	mm.	in.	mm.	lb.	kg.
4	3 7/8	99	10	254	12	305	8	203	24	11
5	4 7/8	124	5	127	12	305	8	203	24	11
6	5 7/8	149	5	127	12	305	8	203	24	11
7	6 7/8	175	5	127	12	305	10	254	28	13
8	7 7/8	200	5	127	12	305	10	254	28	13
9	8 7/8	226	5	127	14	356	12 1/2	318	34	15
10	9 7/8	251	5	127	14	356	12 1/2	318	34	15
12	11 7/8	302	5	127	16	406	15	381	41	19
14	13 7/8	353	5	127	20	508	17 1/2	445	47	21
16	15 7/8	403	5	127	24	610	18	457	54	25
20	19 7/8 X 15 7/8	505 X 403	6	152	30	762	20	508	77	35
24	23 7/8 X 15 7/8	607 X 403	6	152	38	965	20	508	93	42

The control panel will overhang the top and bottom of Units 04 - 06 1" [25.4 mm] Control Panel Mounting Surface width by height is 13⁷/₈" x 9³/₄"

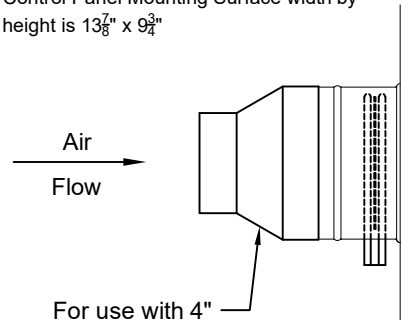

For use with 4" Transition on Standard 6" Inlet Duct

Standard Construction

- | | | |
|---|--|---|
| <ul style="list-style-type: none"> • 1/2" Dual Density, Coated Fiberglass • All Insulations Meet NFPA 90A And UL 181 • All Fiberglass Insulations Have Coated Edges To Prevent Fiber Migration | <ul style="list-style-type: none"> • Units Are Constructed With 22 Gauge Casing & Inlet Duct • 18 Gauge Equivalent Damper Assembly With Integral Blade Seal • Control Panel With Dust Cover | <ul style="list-style-type: none"> • Slip & Drive Discharge Connection • Inlet Airflow Sensor |
|---|--|---|